
























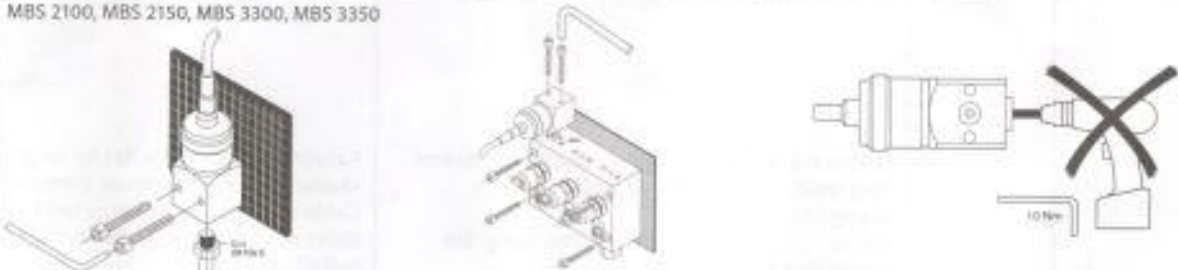


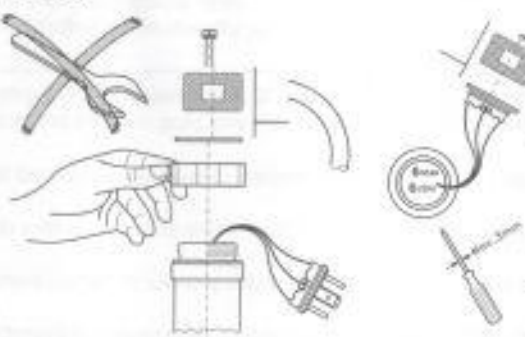
Installation Guide

Pressure Transmitters

MBS 32, MBS 32R, MBS 33, MBS 33M, MBS 2000, MBS 2050, MBS 2100, MBS 2150, MBS 2200, MBS 2250, MBS 3000, MBS 3050, MBS 3100, MBS 3150, MBS 3200, MBS 3250, MBS 3300, MBS 3350, MBS 4003, MBS 4010, MBS 4050, MBS 4510

060R9328

060R9328

	<p>Elektrisk tilslutning: Electrical connection: Elektrischer Anschluss: Raccordement électrique: Conexión eléctrica: Connessione elettrica:</p>							<p>Se produktskilt See product label Siehe Produktschild Voir étiquette du produit Ver la pegatina en el producto Vedi etichetta sulla confezione</p>												
	<p>EN 175301-803</p> 	<p>2m screened cable</p> 	<p>AMP econoseal, J series, male</p> 	<p>AMP superseal 1.5 series (male)</p> 	<p>Deutsch DT04-3P</p> 	<p>Deutsch DT04-4P</p> 	<p>EN60497-5-2 M12 X 1 (4 pin)</p> 	<p>Amphenol 6 pin</p> 												
<p>Universal Mate-N-Lock</p> 	<p>Deutsch DT06-2S</p> 	<p>AMP 173065 (wire)</p> 	<p>ITT Cannon sure seal ss 2-P</p> 	<p>Lumberg RSF 20/11</p> 	<p>KET-2P MG651092</p> 	<p>Round Packard</p> 	<p>ISO 15170-A1-3,2-5n</p> 													
	<p>IEC 947-5-2-M12 x 1 (5 pin)</p> <p>Pin 5: Forbundet til kapsling Pin 5: Connected to enclosure Pin 5: Anschluss an Gehäuse Pin 5: Connecté au boîtier Pin 5: Conectado a la cubierta Polo 5: Collegato al corpo</p>		<p>MBS 32, MBS 32R, MBS 33, MBS 33M, MBS 2000, MBS 2100, MBS 2200, MBS 3000, MBS 3100, MBS 3200, MBS 3300, MBS 4003</p> 		<p>MBS 2050, MBS 2150, MBS 2250, MBS 3050, MBS 3150, MBS 3250, MBS 3350, MBS 4050</p> 		<p>MBS 4000, MBS 4510</p> 													
	<p>MBS 2100, MBS 2150, MBS 3300, MBS 3350</p> 																			
	<p>MBS 4510</p> 																			
	<p>MBS 4510</p> 				<table border="1" data-bbox="1117 1803 1500 1960"> <thead> <tr> <th colspan="2">Zero adjustment</th> </tr> </thead> <tbody> <tr> <td>0-1→0-10 bar</td> <td>-5→+20% FS</td> </tr> <tr> <td>0-16→0-40 bar</td> <td>-5→+10% FS</td> </tr> <tr> <td>0-60→0-600 bar</td> <td>-5→+2.5% FS</td> </tr> </tbody> </table> <table border="1" data-bbox="1149 2016 1460 2094"> <thead> <tr> <th colspan="2">Span adjustment</th> </tr> </thead> <tbody> <tr> <td>-5→+5% FS</td> <td></td> </tr> </tbody> </table>				Zero adjustment		0-1→0-10 bar	-5→+20% FS	0-16→0-40 bar	-5→+10% FS	0-60→0-600 bar	-5→+2.5% FS	Span adjustment		-5→+5% FS	
Zero adjustment																				
0-1→0-10 bar	-5→+20% FS																			
0-16→0-40 bar	-5→+10% FS																			
0-60→0-600 bar	-5→+2.5% FS																			
Span adjustment																				
-5→+5% FS																				